



CERTIFICATE OF QUALITY

EverSure™ Type GP Cement

NZS3122:2009 (Bulk Despatch)



Our
NZ made
cement is
genuine
NZ grade
cement.

Issued to: National Sales Manager

Test Report No:

21#200

info@goldenbay.co.nz

Code	Week Ending / Voyage	Specific Surface Area	Normal Consistency	Initial Set	Final Set	Soundness	Compressive Strength							Free Lime	Sodium Equivalent (NaEq)	Sulphur Trioxide (SO3)
							ISOCEN			Concrete						
							3 days	7 days	28 days	Slump	3 days	7 days	28 days			
Mean		332	29.1	128	3:33	1	30.1	41.7	64.1	94	22.6	33.4	46.7	2.1	0.56	2.2
Standard Deviation		9	0.3	13	0:10	0	1.0	1.1	0.9	6	1.5	1.6	1.8	0.2	0.01	0.04
Min		315	28.8	105	3:15	0	28.2	40.0	62.2	90	20.3	30.8	41.8	1.5	0.54	2.2
Max		350	30.0	150	3:45	2	32.7	44.9	65.4	110	25.8	36.1	48.6	2.5	0.58	2.3
NZS 3122:2009 Requirements				45 min	6:00 max	5 max		35.0 min	45.0 min						0.6 max	3.5 max
Units		m2/kg	%	minutes	hrs:mins	mm	MPa	MPa	MPa	mm	MPa	MPa	MPa	%	%	%
211029-179-GP	29/10/21	325	28.9	105	3:30	2	30.3			90	20.3			1.9	0.57	2.2
211026-181-GP	26/10/21	325	28.8	120	3:45	2	30.9							1.9	0.57	2.2
211022-784-GP	22/10/21	320	28.8	150	3:45	1	29.4	40.1		90	22.7			2.1	0.58	2.2
211019-782-GP	19/10/21	320	28.9	135	3:15	1	29.8	40.0						2.2	0.56	2.3
211012-419-GP	12/10/21	335	29.0	120	3:30	2	28.2	41.1		100	22.9	32.5		2.2	0.55	2.3
211011-421-GP	11/10/21	335	28.8	120	3:30	2	28.7	41.8						2.0	0.56	2.3
211008-086-GP	08/10/21	315	29.0	120	3:30	1	31.1	41.6		90	23.1	34.8		2.0	0.54	2.3
211006-084-GP	06/10/21	325	28.8	135	3:30	0	32.7	43.2						2.1	0.57	2.2
211002-726-GP	02/10/21	340	29.0	120	3:15	2	31.0	42.5	64.6					2.1	0.55	2.2
210930-724-GP	30/09/21	330	29.0	135	3:45	2	29.1	42.0	63.2	90	22.7	32.4	47.4	1.8	0.57	2.2
210925-524-GP	25/09/21	335	30.0	120	3:15	2	29.8	40.5	62.2					2.5	0.57	2.3
210922-522-GP	22/09/21	340	29.9	105	3:15	2	30.6	40.7	63.5	90	21.4	30.8	46.2	2.0	0.57	2.3
210917-309-GP	17/09/21	320	29.2	135	3:30	2	30.4	42.1	65.4	90	23.1	34.9	46.9	1.7	0.56	2.2
210907-028-GP	07/09/21	330	29.0	135	3:45	1	30.6	41.8	64.4	90	24.8	35.0	47.6	2.1	0.55	2.2
210829-778-GP	29/08/21	335	29.3	150	3:45	1	30.6	42.1	63.5	90	25.8	36.1	47.3	2.0	0.57	2.2
210824-505-GP	24/08/21	325	29.2	120	3:30	1	30.5	42.0	64.8	90	22.1	32.9	45.7	2.1	0.57	2.3
210822-503-GP	22/08/21	345	29.1	120	3:30	1	30.3	42.8	64.8					2.0	0.58	2.3
210816-411-GP	16/08/21	325	28.8	135	3:45	1	29.6	42.2	65.0	100	22.0	31.9	47.4	2.1	0.55	2.2
210811-938-GP	11/08/21	345	28.8	135	3:30	1	29.9	44.9	64.1					1.9	0.56	2.2
210808-936-GP	08/08/21	335	29.0	150	3:45	1	30.1	41.2	63.3	100	20.9	31.2	47.6	1.5	0.56	2.2
210806-591-GP	06/08/21	340	29.1	135	3:45	2	29.0	40.4	63.7					2.4	0.56	2.2
210801-588-GP	01/08/21	350	29.1	135	3:45	1	28.6	40.9	64.1	90	23.3	34.7	47.6	2.2	0.54	2.2
210730-453-GP	30/07/21	330	29.1	135	3:45	1	31.2	40.9	63.9					2.3	0.55	2.2
210725-283-GP	25/07/21	325	29.3	135	3:30	1	31.3	42.1	64.7	110	23.3	32.9	41.8	2.1	0.56	2.2
210722-075-GP	22/07/21	345	29.4	105	3:30	1	29.4	41.6	65.3	100	20.8	33.9	48.6	2.0	0.58	2.2

The above samples were tested as received in accordance with the current terms of accreditation and methods stated in NZS 3122:2009 with the exception of:

Chemical composition to ASTM C114-18

- Concrete Compressive Strength test results outside the scope of accreditation

Tested Outside Scope Of Accreditation

No result available at time of certificate issue

This Report must not be reproduced except in full

Raki Harding
Technical Manager



Portland Works, Portland, Whangarei 0178

Date issued: 4/11/2021

Page 1 of 3




**EverSure™
Type GP Cement**



**Compressive Strength ISO-CEN Mortar
(Bulk Dispatch)**

—▲— 28 Days —■— 7 Days —◆— 3 Days

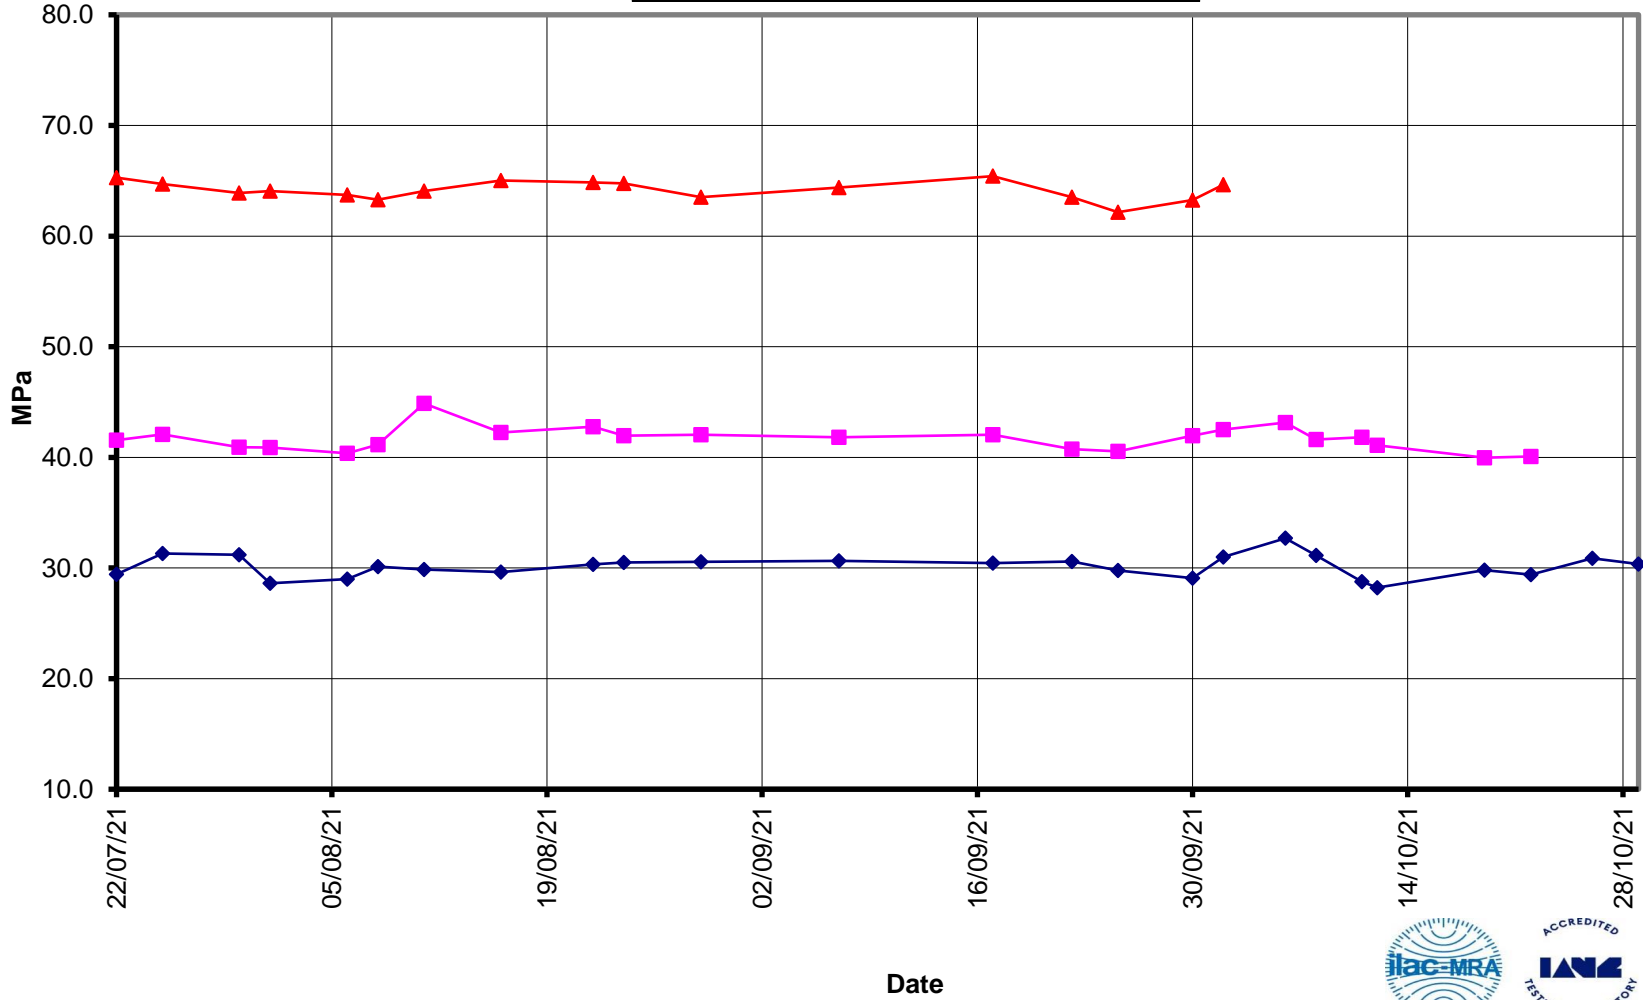



EverSure™ Type GP Cement



Compressive Strength Concrete (Bulk Dispatch)

—x— 28 Days —■— 7 Days —◆— 3 Days —x— Slump

